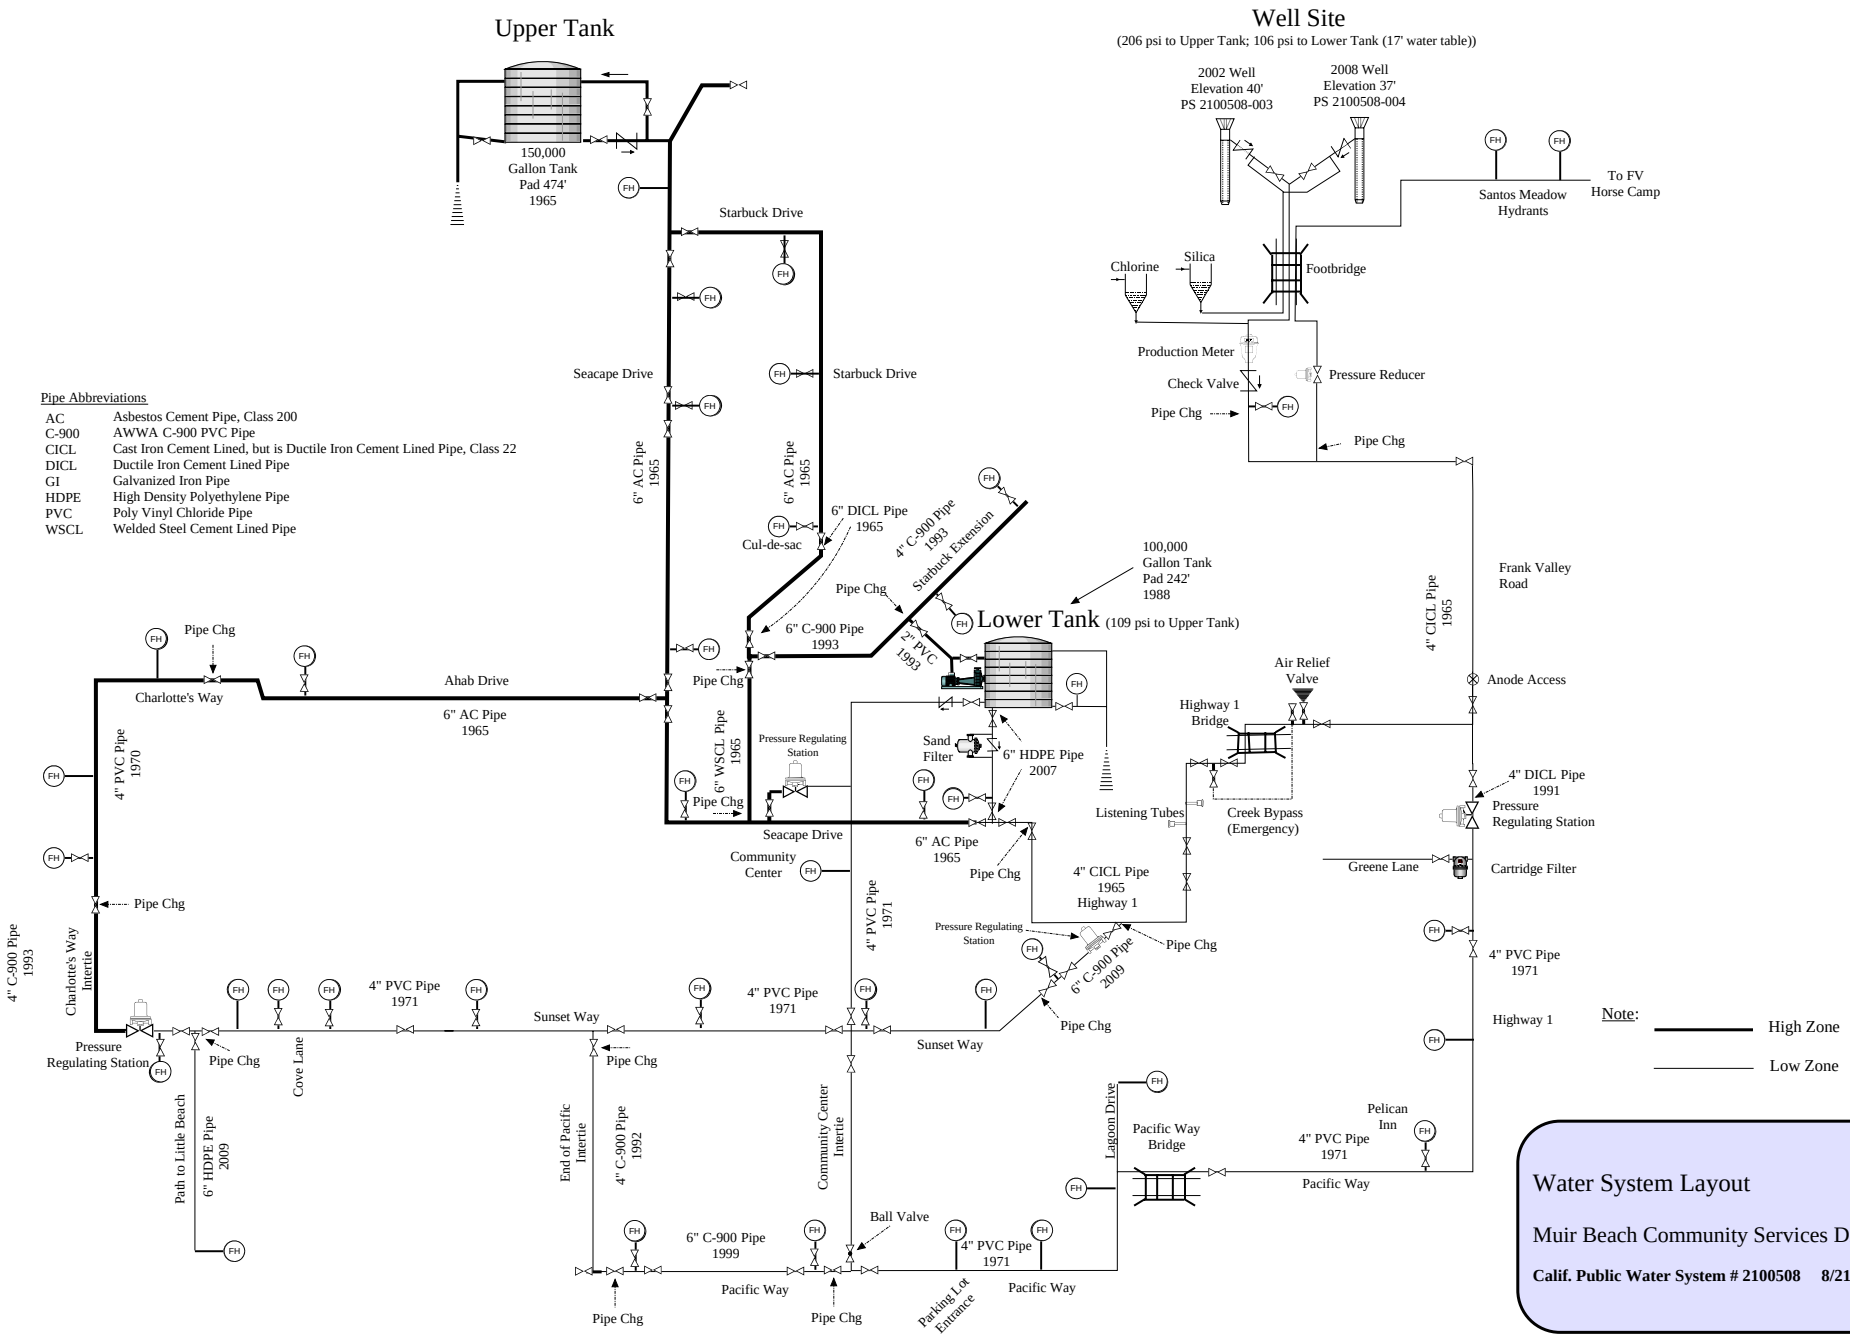

Pipe Abbreviations

AC	Asbestos Cement Pipe, Class 200
C-900	AWWA C-900 PVC Pipe
CICL	Cast Iron Cement Lined, but is Ductile Iron Cement Lined Pipe, Class 22
DICL	Ductile Iron Cement Lined Pipe
GI	Galvanized Iron Pipe
HDPE	High Density Polyethylene Pipe
PVC	Poly Vinyl Chloride Pipe
WSCL	Welded Steel Cement Lined Pipe

Water System Layout

Muir Beach Community Services District

Calif. Public Water System # 2100508 8/21/2009 LH